


XT1: Electric Control Cabinet Terminal Blocks

1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	
L11	L21	L31	N	N	EH1	EH2	EH3	EH4	EH5	EH6	EH7	EH8	EH9	U1	V1	W1	U2	V2	W2		T10		SQ		RT1			RTH		KA1		KM1		KA				
																	U21	V21	W21		204	206	81	80	03	81	90	94	81	80	95	20	22	24	26	81	04	
Power Supply				1#Electrical Heat				2#Electrical Heat				3#Electrical Heat				Process Fan		React. Fan Rotor Motor			Temperature Control Switch of React. Heating		Proximity Switches			React. Tempe Sensor		Return Air Temperature And Humidity Sensor				Fault Signal		Running Signal		Start/Stop Signal		
380VAC 50Hz																																						

Terminal Blocks
Cabinet








DA260-D3

Main Power Switch (Users Provide)	Process Fan	React. Fan	Rotor Motor	1#Electrical Heat	2#Electrical Heat	3#Electrical Heat	Socket Power	Control Power Supply
18, 24kW	0, 75kW/1, 93A	0, 37kW/3, 4A	60W/0.25A	2, 64kW/27A	1, 76kW/18A	0, 88kW/9A	220VAC	220VAC

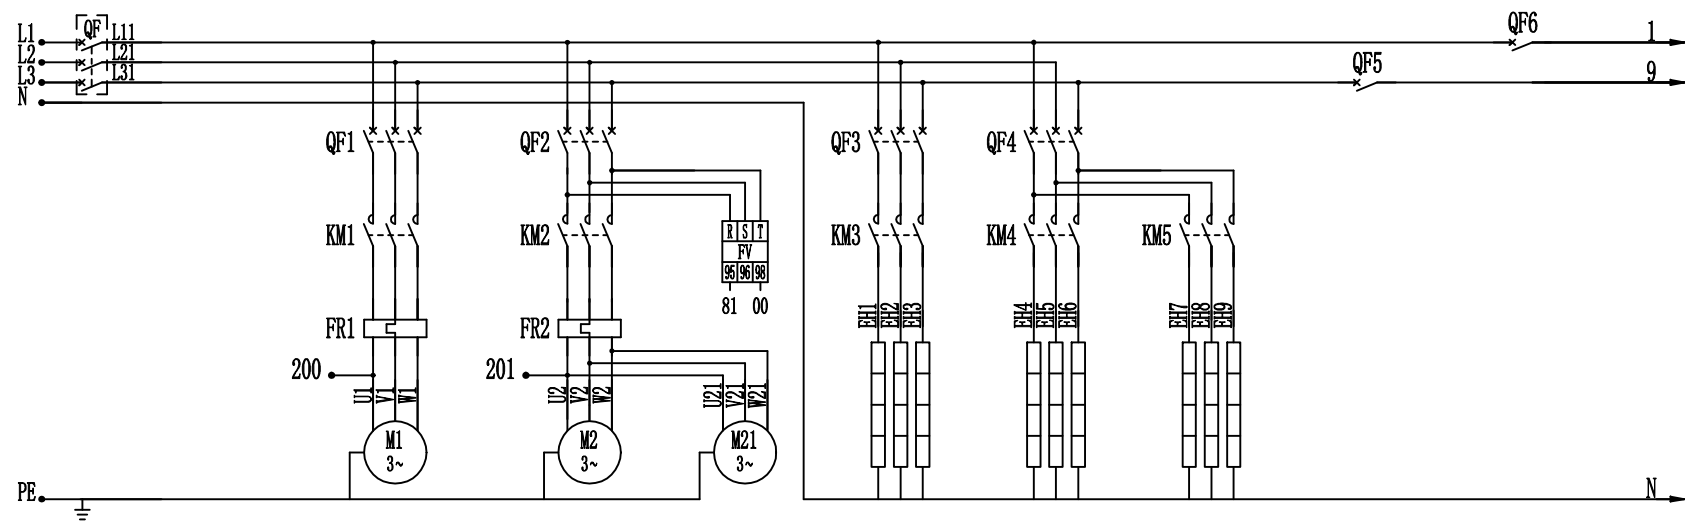

Electric Schematic
Diagram


DA260-D1

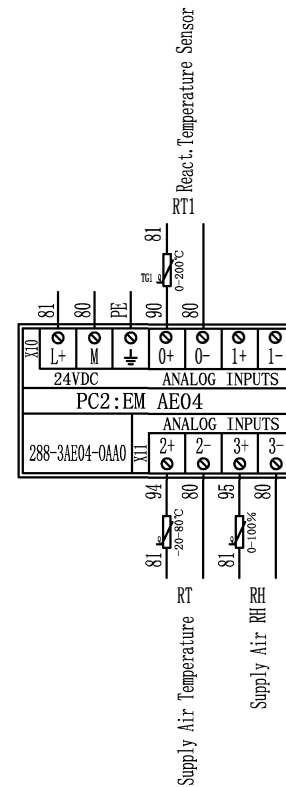

1、The temperature sensor must adopt shielded wire case of interference.

connection, in

Wiring diagram of
temperature control switch



PLC wiring diagram

DA260-D2